


1/E-1.1 ELECTRICAL NOTES

- ① CONTRACTOR TO COORDINATE WITH COOS CURRY ELECTRIC FOR PLACEMENT OF NEW TRANSFORMER. CONTRACTOR TO FIELD LOCATE EXISTING 4" (FIELD VERIFY) CONDUIT SERVING EXISTING TRANSFORMER, REROUTE CONDUIT TO NEW TRANSFORMER LOCATION.
- ② CONTRACTOR TO PROVIDE NEW 400 AMP SERVICE TO NEW LAUNDRY BUILDING UNDER ALTERNATE #4, PROVIDE NEW PANEL PER SCHEDULE.
- ③ CONTRACTOR TO PROVIDE NEW 600 AMP 120/240 VOLT SERVICE TO SERVE 10 NEW SITES AND 10 EXISTING SITES 58-77. PROVIDE NEW 50 AMP PEDESTAL, HYPOWER POWERPORT RV OR APPROVED, COMPLETE WITH WEATHER BASE, POWERSNAP PANEL WITH BREAKERS, 50 AMP, 30 AMP AND 20 AMP GFCI RECEPTACLES, CAP WITH LIGHT. PROVIDE 24"x24"x4" CONCRETE PAD FOR MOUNTING. ROUTE CABLE FOR TELEVISION THROUGH PEDESTAL. CONTRACTOR TO PROVIDE 200 AMP 120/240 VOLT SINGLE PHASE CIRCUIT FROM SERVICE TO NEW SHOWER BUILDING. (3) 250 MCM (1) #2 ALUMINUM IN 3" CONDUIT. VERIFY CIRCUIT SIZE AND LOCATION OF PANEL IN SHOWER BUILDING WITH BUILDING MANUFACTURER PRIOR TO ROUGH IN.
- ④ ALTERNATE #1:
CONTRACTOR TO COORDINATE WITH COOS CURRY ELECTRIC FOR REPLACEMENT OF EXISTING TRANSFORMER WITH NEW TRANSFORMER. PROVIDE NEW 50 AMP SERVICES TO 26 EXISTING SITES 78-103. PROVIDE NEW 50 AMP PEDESTAL, HYPOWER POWERPORT RV OR APPROVED, COMPLETE WITH WEATHER BASE, POWERSNAP PANEL WITH BREAKERS, 50 AMP, 30 AMP AND 20 AMP GFCI RECEPTACLES, CAP WITH LIGHT. PROVIDE 24"x24"x4" CONCRETE PAD FOR MOUNTING. CONTRACTOR TO MAINTAIN CIRCUITS SERVING OTHER SERVICES. ROUTE CABLE TELEVISION THROUGH PEDESTAL.
- ⑤ ALTERNATE #2:
CONTRACTOR TO COORDINATE WITH COOS CURRY ELECTRIC FOR REPLACEMENT OF EXISTING TRANSFORMER WITH NEW TRANSFORMER. PROVIDE NEW 600 AMP 120/240 VOLT SERVICE TO 26 EXISTING SITES 32-57. PROVIDE NEW 50 AMP PEDESTAL FOR SITES 32-48, HYPOWER POWERPORT RV OR APPROVED, COMPLETE WITH WEATHER BASE, POWERSNAP PANEL WITH BREAKERS, 50 AMP, 30 AMP AND 20 AMP GFCI RECEPTACLES, CAP WITH LIGHT. PROVIDE 24"x24"x4" CONCRETE PAD FOR MOUNTING. ROUTE CABLE TELEVISION THROUGH PEDESTAL. MAINTAIN EXISTING CIRCUIT TO SITES 49-57, PROVIDE NEW BREAKER IN NEW SERVICE PANEL.
- ⑥ ALTERNATE #2:
CONTRACTOR TO COORDINATE WITH COOS CURRY ELECTRIC TO PROVIDE NEW 600 AMP 120/240 VOLT SERVICE TO 25 EXISTING SITES 1-27. PROVIDE NEW 50 AMP PEDESTAL, HYPOWER POWERPORT RV OR APPROVED, COMPLETE WITH WEATHER BASE, POWERSNAP PANEL WITH BREAKERS, 50 AMP, 30 AMP AND 20 AMP GFCI RECEPTACLES, CAP WITH LIGHT. PROVIDE 24"x24"x4" CONCRETE PAD FOR MOUNTING. ROUTE CABLE TELEVISION THROUGH PEDESTAL.
- ⑦ ALTERNATE #4: CONTRACTOR TO PROVIDE 200 AMP 120/240 VOLT SINGLE PHASE CIRCUIT FROM LAUNDRY BUILDING TO NEW SHOWER BUILDING. (3) 250MCM (1) #2 ALUMINUM IN 3" CONDUIT. VERIFY CIRCUIT SIZE AND LOCATION OF PANEL IN SHOWER BUILDING WITH BUILDING MANUFACTURER PRIOR TO ROUGH IN.
- ⑧ CONTRACTOR TO REMOVE EXISTING SERVICE GEAR IN ELECTRICAL SHED, PROVIDE NEW 600 AMP 120/240 VOLT SERVICE TO SERVE EXISTING SITES 78-103. CONTRACTOR TO PROVIDE (3) 125 AMP 2 POLE BREAKERS AND (1) 40 AMP 2 POLE BREAKER, MAINTAIN CONDUIT AND CONDUCTORS TO EXISTING SITES, LABEL PANEL WITH NEW SITE NUMBERS.
- ⑨ CONTRACTOR TO COORDINATE WITH COOS CURRY ELECTRIC FOR RELOCATION OF EXISTING TRANSFORMER. CONTRACTOR TO FIELD LOCATE EXISTING 4" (FIELD VERIFY) CONDUIT SERVING EXISTING TRANSFORMER, REROUTE CONDUIT TO NEW TRANSFORMER LOCATION.

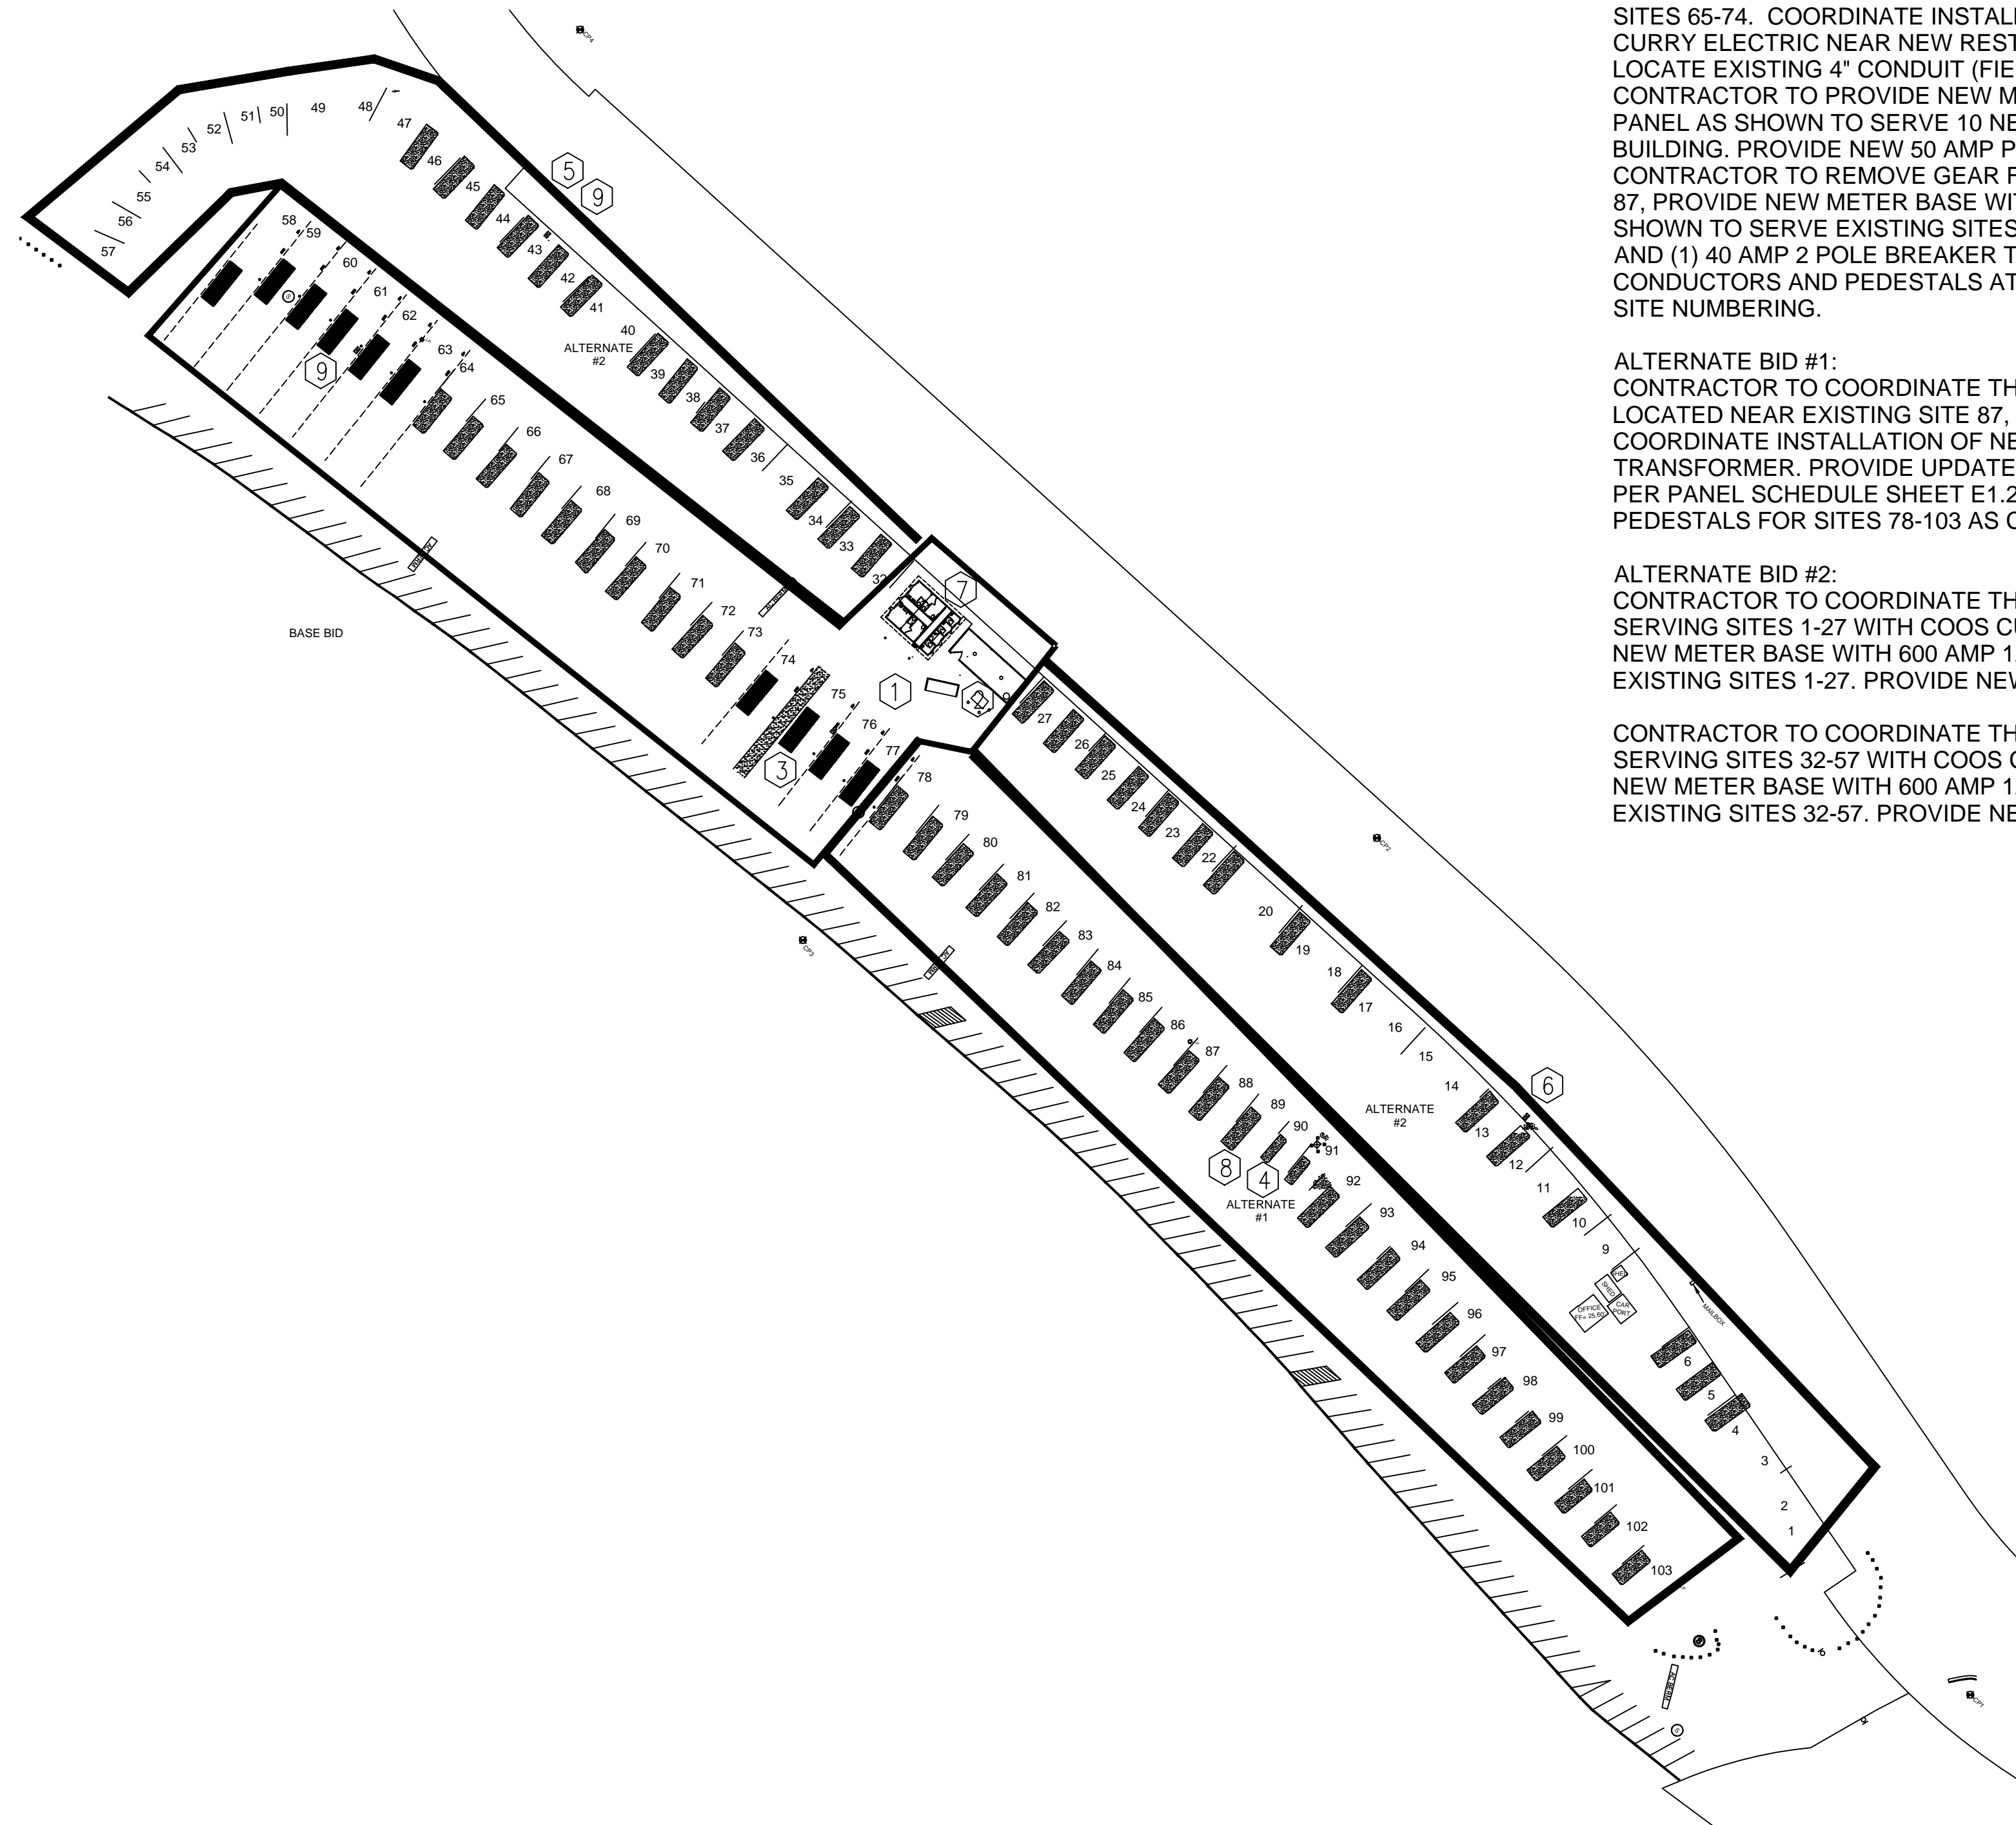

1 SITE ELECTRICAL PLAN
SCALE: 1/64" = 1'-0"

GENERAL NOTES

- UNLESS OTHERWISE NOTED 120 VOLT 20 AMP BRANCH CIRCUITS SHALL BE (2) #12 THHN, (1) #12 GRND. 1/2" CONDUIT OR IN MC CABLE.
- CONTRACTOR TO VERIFY LOCATIONS OF EQUIPMENT AND DEVICES WITH ARCHITECTURAL DRAWINGS PRIOR TO ROUGH IN.
- CONTRACTOR TO FIELD VERIFY CIRCUITS PRIOR TO DEMOLITION.
- CONTRACTOR TO PROVIDE PERMANENT, TYPE WRITTEN PANEL SCHEDULES.
- CONTRACTOR TO COORDINATE INSTALLATION OF NEW ELECTRICAL COMPONENTS AND DEVICES WITH GENERAL CONTRACTOR. ALL NEW CONDUIT, BOXES AND COMPONENTS TO BE CONCEALED IN WALLS WHERE POSSIBLE. ALL EXPOSED EQUIPMENT AND WIRING TO BE STRAIGHT AND TRUE TO THE STRUCTURE AND INSTALLED IN RIGID CONDUIT.
- CONTRACTOR TO COORDINATE ELECTRICAL REQUIREMENTS WITH PLUMBING CONTRACTOR.
- CONTRACTOR TO FIELD LOCATE CIRCUITS TO EXISTING POLE LIGHTS, CONTRACTOR TO MAINTAIN POWER TO EXISTING POLE LIGHTS THROUGH EXISTING OR REPLACED PANELS.

BASE BID:
CONTRACTOR TO COORDINATE WITH COOS CURRY ELECTRIC TO REMOVE EXISTING TRANSFORMER NEXT TO EXISTING SHOWER BUILDING, SEE SHEET E1.0. REMOVE EXISTING ELECTRICAL FROM EXISTING SHOWER BUILDING AND ELECTRICAL SERVING EXISTING SITES 65-74. COORDINATE INSTALLATION OF NEW 167KVA TRANSFORMER, WITH COOS CURRY ELECTRIC NEAR NEW RESTROOM/SHOWER BUILDING. CONTRACTOR TO FIELD LOCATE EXISTING 4" CONDUIT (FIELD VERIFY), ROUTE TO NEW TRANSFORMER LOCATION. CONTRACTOR TO PROVIDE NEW METER BASE WITH 600 AMP 120/240 VOLT SINGLE PHASE PANEL AS SHOWN TO SERVE 10 NEW SITES, 10 EXISTING SITES AND NEW SHOWER BUILDING. PROVIDE NEW 50 AMP PEDESTALS AS CALLED OUT FOR THE 20 SITES. CONTRACTOR TO REMOVE GEAR FROM EXISTING ELECTRICAL SHED NEAR EXISTING SITE 87, PROVIDE NEW METER BASE WITH 600 AMP 120/240 VOLT SINGLE PHASE PANEL AS SHOWN TO SERVE EXISTING SITES 76-98, PROVIDE (3) NEW 125 AMP 2 POLE BREAKERS AND (1) 40 AMP 2 POLE BREAKER TO REPLACE EXISTING, MAINTAIN EXISTING CONDUIT, CONDUCTORS AND PEDESTALS AT EXISTING SITES, PROVIDE PANEL SCHEDULE WITH NEW SITE NUMBERING.

ALTERNATE BID #1:
CONTRACTOR TO COORDINATE THE REPLACEMENT OF THE EXISTING TRANSFORMER LOCATED NEAR EXISTING SITE 87, SEE SHEET E1.0 WITH COOS CURRY ELECTRIC. COORDINATE INSTALLATION OF NEW 167 KVA 120/240 VOLT SINGLE PHASE TRANSFORMER. PROVIDE UPDATED CIRCUITS IN NEW PANEL PROVIDED UNDER BASE BID PER PANEL SCHEDULE SHEET E1.2 TO SERVE SITES 78-103. PROVIDE NEW 50 AMP PEDESTALS FOR SITES 78-103 AS CALLED OUT.

ALTERNATE BID #2:
CONTRACTOR TO COORDINATE THE REMOVAL OF THE EXISTING 200 AMP SERVICE SERVING SITES 1-27 WITH COOS CURRY ELECTRIC. COORDINATE THE INSTALLATION OF A NEW METER BASE WITH 600 AMP 120/240 VOLT SINGLE PHASE PANEL AS SHOWN TO SERVE EXISTING SITES 1-27. PROVIDE NEW 50 AMP PEDESTALS FOR SITES 1-27 AS CALLED OUT.

CONTRACTOR TO COORDINATE THE REMOVAL OF THE EXISTING 200 AMP SERVICE SERVING SITES 32-57 WITH COOS CURRY ELECTRIC. COORDINATE THE INSTALLATION OF A NEW METER BASE WITH 600 AMP 120/240 VOLT SINGLE PHASE PANEL AS SHOWN TO SERVE EXISTING SITES 32-57. PROVIDE NEW 50 AMP PEDESTALS FOR SITES 32-57 AS CALLED OUT.

125 WEST CENTRAL AVENUE
SUITE 400
COOS BAY, OREGON 97420
TEL: (541) 269-5388
www.crowclay.com

CROW/CLAY & ASSOCIATES INC.
ARCHITECTURE AND PLANNING
LAND USE AND INTERIORS

REGISTERED PROFESSIONAL ENGINEER
61438PE
DAVID CHARLES BICKMEYER
EXPIRES: 12/31/2021

PORT OF BROOKINGS HARBOR
RV PARK -
BOAT BASIN ROAD
BROOKINGS, OREGON 97415

REVISIONS	Date:
Revision:	
No:	

SEPT 2020
PROJECT NO: 19005

E1.1